

Idaho Department of Environmental Quality Reuse Permit I-095-04

(Previous Permit No. LA-000095-03)

CTI-SSI Food Services, LLC (hereafter "permittee") is hereby authorized to construct, install, and operate a reuse facility in accordance with (1) this permit; (2) IDAPA 58.01.17 "Recycled Water Rules"; (3) an approved plan of operation; and (4) all other applicable federal, state, and local laws, statutes, and rules. This permit is effective from the date of signature and expires on June 30, 2019.



Signature



Date

Pete Wagner
Regional Administrator
Boise Regional Office
Idaho Department of Environmental Quality

Department of Environmental Quality
Boise Regional Office
1445 N. Orchard St.
Boise, ID 83706
(208) 373-0550

This page intentionally left blank for correct double-sided printing.

Table of Contents

1. Common Acronyms/Abbreviations and Definitions	5
2. Facility Information	7
3. Compliance Schedule for Required Activities.....	8
4. Permit Limits and Conditions	12
4.1 Hydraulic Management Unit Descriptions	12
4.2 Hydraulic Loading Limits.....	12
4.3 Constituent Loading Limits	13
4.4 Management Unit Buffer Zones	13
4.5 Other Permit Limits and Conditions	14
5. Monitoring Requirements	15
5.1 Recycled Water and Supplemental Irrigation Water Sampling and Analyses	15
5.1.1 Constituent Monitoring.....	15
5.1.2 Management Unit and Other Flow Monitoring.....	17
5.2 Ground Water Monitoring	18
5.2.1 Ground Water Monitoring Point Descriptions	18
5.2.2 Ground Water Monitoring, Sampling, and Analyses	19
5.3 Soil Monitoring.....	20
5.3.1 Soil Monitoring Unit Descriptions	20
5.3.2 Soil Monitoring, Sampling, and Analyses.....	20
5.4 Crop Monitoring	21
5.4.1 Crop Harvest Monitoring.....	21
5.4.2 Plant Tissue Monitoring	21
5.5 Lagoon Information	21
6. Reporting Requirements	22
6.1 Annual Report Requirements.....	22
6.1.1 Due Date	22
6.1.2 Required Contents	22
6.1.3 Submittals	24
6.2 Emergency and Non-compliance Reporting.....	25
7. Permit for Use of Industrial Recycled Water.....	26
8. Standard Permit Conditions	26
9. General Permit Conditions.....	28
9.1 Operations.....	28
9.1.1 Backflow Prevention	28
9.1.2 Restricted to Premises	28
9.1.3 Health Hazards, Nuisances, and Odors Prohibited.....	29
9.1.4 Solids Management	29
9.1.5 Temporary Cessation of Operations and Closure (IDAPA 58.01.17.801).....	30
9.1.6 Plan of Operation (IDAPA 58.01.17.300.05).....	30
9.1.7 Reserved	30
9.1.8 Ground Water Quality Rule (IDAPA 58.01.11).....	30
9.2 Administrative.....	31
9.2.1 Permit Modification (IDAPA 58.01.17.700).....	31

9.2.2	Permit Transferable (IDAPA 58.01.17.800)	31
9.2.3	Permit Revocation (IDAPA 58.01.17.920)	31
9.2.4	Violations (IDAPA 58.01.17.930).....	32
9.2.5	Severability.....	32
10.	Other Applicable Laws	32
10.1	Owner Responsibilities for Well Use and Maintenance	32
10.1.1	Well Use	32
10.1.2	Well Maintenance.....	32
10.1.3	Wells Posing a Threat to Human Health and Safety or Causing Contamination of the Ground Water Resource	33
11.	Site Maps	34

1. Common Acronyms/Abbreviations and Definitions

cwt	a unit of weight measurement equal to 100 pounds
DEQ	Idaho Department of Environmental Quality
DEQ Guidance	DEQ Guidance for Reclamation and Reuse of Municipal and Industrial Wastewater, latest revision
Director	Director of the Idaho Department of Environmental Quality or designee unless otherwise specified
EPA	Environmental Protection Agency
E_i	irrigation efficiency
FM	flow measurement or monitoring description or identifier
GW	prefix for ground water reporting serial number
IDAPA	Idaho Administrative Procedures Act
IDWR	Idaho Department of Water Resources
IWR	irrigation water requirement - any combination of wastewater and supplemental irrigation water applied at rates commensurate to the moisture requirements of the crop, and calculated monthly during the growing season (GS). The equation used to calculate the IWR is: $IWR = P_{def} / E_i$
LG	prefix for lagoon reporting serial number
MG	million gallons
mg/kg	milligram per kilogram
mg/L	milligram per liter
MU	prefix for management unit reporting environmental serial number
NPDES	National Pollutant Discharge Elimination System
P_{def}	precipitation deficit - is synonymous with the net irrigation water requirement of the crop and for the purposes of this permit can be found at the following website http://data.kimberly.uidaho.edu/ETIdaho/
PO	plan of operation
QAPP	quality assurance project plan
Responsible Official	is the facility contact person authorized by the permittee to communicate with DEQ on behalf of the permittee on any matter related to the permit, including without limitation, the authority to communicate with and receive notices from DEQ regarding notices of violation or non-compliance, permit violations, permit enforcement, and permit revocation. The Responsible Official is also responsible for providing written certification of permit application materials, annual report submittals, and

other information submitted to DEQ as required by the permit. Any notice to or communication with the Responsible Official is considered a notice to or communication with the permittee. The Responsible Official may designate an Authorized Representative to act as the facility contact person for any of the activities or duties related to the permit, except signing and certifying the permit application, which must be done by the Responsible Official. The Authorized Representative shall act as the Responsible Official and shall bind the permittee as described in this definition. Designation of the Authorized Representative shall follow the requirements specified in Section 6.1.3 of the permit.

SU

prefix for soil monitoring unit reporting serial number

SW

prefix for supplemental irrigation water reporting serial number

WW

prefix for wastewater reporting serial number

2. Facility Information

Information Type	Information Specific to This Permit
Type(s) of recycled water	Industrial: Meat processing wastewater mixed with truck and parking lot washdown waters.
Method of treatment and reuse	Slow Rate Application, pre-treatment from rotating drum screen and dissolved air flotation.
Facility location	22303 Highway 95, Wilder, ID 83676, Canyon County Township 4 North, Range 5 West, Sections 8 and 17
Facility mailing address	22303 Highway 95 Wilder, ID 83676 Canyon County Telephone: (208) 482-7844
Facility responsible official and authorized representative	Responsible Official: Dave Kubosumi, Vice President Engineering, (208) 482-4262, dkubosumi@ctifoods.com Authorized Representative: Bob Cooper, Senior Executive Director of Engineering, (208) 482-4211, becooper@ctifoods.com Notify DEQ within 30 days if there is a change in personnel for any of the above facility contacts. A minor permit modification will be issued by DEQ to confirm the change
Ground Water	An unconfined aquifer extends from a high seasonal level of 26 to 77 feet below the ground surface to 200 feet below. Ground water flow is to the west – southwest. Ground water is used for agricultural, industrial, domestic purposes and is located in the Ada County Nitrate priority area. No public water supply wells are located nearby the reuse site.
Surface Water	The Snake River is 4,300 feet southwest of the nearest reuse site. The river has beneficial uses of agricultural, industrial, domestic, recreational, and aquatic life. The Arena Canal is located 1,500 feet to the northeast of the application site.

3. Compliance Schedule for Required Activities

Compliance Activity (CA) Number and Completion Due Date	Compliance Activity Description
CA-095-01 Six (6) months from permit issuance	<p>Plan of Operation (PO): The permittee shall submit for review and approval an updated Plan of Operation (PO) that reflects current operations and incorporates the requirements of this permit. The PO shall comply with the applicable requirements stated in IDAPA 58.01.17.300.05 and shall address applicable items in the Plan of Operation Checklist in the DEQ Guidance.</p> <p>The PO shall include the following site management plans or the permittee may submit the site management plans individually:</p> <ol style="list-style-type: none"> 1. Emergency operating plan; 2. Updated F-N land management plan <p>The PO shall be updated as needed to reflect current operations. The permittee shall notify DEQ of material changes to the PO and copies shall be kept on site and made available to DEQ upon request.</p>
CA-095-02 Six (6) months from permit issuance	<p>Quality Assurance Project Plan (QAPP): The permittee shall prepare and implement a QAPP that incorporates all monitoring and reporting required by this permit. A copy of the QAPP along with written notice that the permittee has implemented the QAPP shall be provided to DEQ.</p> <p>The QAPP shall be designed to assist in planning for the collection, analysis, and reporting of all monitoring in support of this permit and in explaining data anomalies when they occur. At a minimum, the QAPP must include the following:</p> <ol style="list-style-type: none"> 1. Details on the number of measurements, number of samples, type of sample containers, preservation of samples, holding times, analytical methods, analytical detection, and quantitation limits for each target compound, type and number of quality assurance field samples, precision and accuracy requirements, sample preparation requirements, sample shipping methods, and laboratory data delivery requirements. 2. Maps indicating the location of each monitoring and sampling point. 3. Qualification and training of personnel. 4. Names, addresses, and telephone numbers of the laboratories used by or proposed to be used by the permittee. 5. Example formats and tables that will be used by the permittee to summarize and present all data in the annual report. <p>The format and content of the QAPP should adhere to the recommendations and references in the Quality Assurance and Data Processing sections of the DEQ Guidance.</p> <p>The permittee shall amend the QAPP whenever there is a modification in sample collection, sample analysis, or other procedure addressed by the QAPP. The permittee shall notify DEQ of material changes to the QAPP, and copies shall be kept on site and made available to DEQ upon request.</p>

Compliance Activity (CA) Number and Completion Due Date	Compliance Activity Description
CA-095-03 Six (6) months after permit issuance	<p>Water Quality Improvement Plan: The Water Quality Improvement Plan to be submitted to DEQ for review and approval shall specify the actions and procedures the permittee will implement toward the goal of bringing ground water quality into compliance with the Ground Water Quality Rule at monitoring wells GW-09504 (MW-4S), GW-09505 (MW-5S), and GW-09506 (MW-6S). Compliance would be determined by whether the trends in concentrations of nitrate measured in monitoring wells GW-09504, GW-09505, and GW-09506 and in the differences in concentration between GW-09501 (MW-1S) and GW-09505 (MW-5S), GW-09513 (MW-10SB) and GW-09506 (MW-6S), and GW-09510 (MW-7S) and GW-09504 (MW-4S) show that impacts to ground water across the reuse sites associated with these wells are decreasing, recognizing that up-gradient influences may influence nitrogen concentrations, trends, and differences between the wells. Analytical methods used to determine the significance of the trends measured in or across the wells shall also be described in the Plan. Alternate confirmatory methods may also be proposed by the permittee.</p> <p>Upon approval of this Plan, the permittee shall continue to operate the facility in accordance with the approved Plan for the duration of the permit. Any changes or modifications to operations identified in the approved Plan shall be reviewed and approved by DEQ prior to implementation.</p>

Compliance Activity (CA) Number and Completion Due Date	Compliance Activity Description
CA-095-04 Twelve (12) months after permit issuance	<p>Non-Volatile Dissolved Solids (NVDS) Source Analysis: The permittee shall revisit and provide an update of the TDS and Related Constituents Management Plan, CA-095-03 from LA-000095-03.</p> <p>The updated plan shall:</p> <ol style="list-style-type: none"> 1. Review and summarize the conclusions and results from the sampling activities undertaken during the implementation of the TDS and Related Constituents Management Plan, CA-095-03 from LA-000095-03, describing each influent stream and the major sources of the non-volatile dissolved solids (TDS minus VDS) for each stream, updated for current plant operations if necessary. Resampling would not be required if changes in plant operation have only been in scale or if inputs from new NVDS sources are easily calculable. 2. Estimate the relative magnitude of the NVDS loading contributed by each source. 3. Compare the technical and economic feasibility of isolating or removing NVDS from the streams at the Plant, to reducing NVDS loading through the acquisition of additional land, more widespread use of canal water for irrigation, or by other means of reducing the NVDS loading rate, and propose a plan for reducing NVDS loading. Calculate by what amount the total NVDS loading is expected to be reduced by the plan, and propose a schedule for its implementation. <p>The permittee shall submit a report containing the results of the analysis, and the proposed implementation schedule to DEQ for review within 12 months of permit issuance. The report and schedule is subject to DEQ review and approval, and the elimination or reduction of non-volatile dissolved solids sources shall be implemented in accordance with the approved schedule.</p>
CA-095-05 Eighteen (18) months after permit issuance	<p>Well Location Acceptability Analysis: The permittee shall submit for review and approval a well location acceptability analysis for the Rogers, Murray, and Johnson wells and any wells that have been drilled within a quarter mile of the reuse site since the most recent well location acceptability analysis, with . The analysis should be completed by following the requirements of Section 6.6.4.1 in the DEQ <i>Guidance for Reclamation and Reuse of Municipal Wastewater</i> based on an updated review of the site's ground water characteristics.</p>

Compliance Activity (CA) Number and Completion Due Date	Compliance Activity Description								
CA-095-06 As specified	<p>Seepage Testing: The following table shows the date by which the permittee shall complete seepage testing on the specified lagoons:</p> <table border="1" data-bbox="467 464 1356 632"> <thead> <tr> <th>Lagoon:</th> <th>Seepage Test Due Date:</th> </tr> </thead> <tbody> <tr> <td>LG-09501</td> <td>May/2015</td> </tr> <tr> <td>LG-09504</td> <td>November/2019</td> </tr> <tr> <td>LG-09505</td> <td>April/2015</td> </tr> </tbody> </table> <p>Submit to DEQ for review and approval a proposed schedule and procedure for performing the required seepage tests at least 42 days prior to the planned seepage test. Seepage test procedures are available at: http://www.deq.idaho.gov/water-quality/wastewater/lagoon-seepage-testing.aspx The seepage test procedures shall be sealed by the Idaho licensed professional engineer or professional geologist in responsible charge for the test.</p> <p>Seepage tests shall be completed in accordance with the procedures approved by DEQ. The seepage test report shall be sealed by the person in responsible charge and submitted within 90 days after completion of the seepage test.</p> <p>The leakage rate for lagoons shall be no more than zero point twenty-five (0.25) inches (1/4 inch) per day.</p> <p>If a lagoon's leakage rate is above the allowable rate specified above, the permittee is required to repair the leak and retest for compliance, re-line the lagoon and retest for compliance, drain the lagoon in an approved manner and stop using the lagoon, or determine the impact of the leaking lagoon on the environment based on ground water modeling using procedures approved by DEQ.</p>	Lagoon:	Seepage Test Due Date:	LG-09501	May/2015	LG-09504	November/2019	LG-09505	April/2015
Lagoon:	Seepage Test Due Date:								
LG-09501	May/2015								
LG-09504	November/2019								
LG-09505	April/2015								
CA-095-07 Twelve (12) months before permit expiration	<p>Pre-Application Workshop: If the permittee intends to continue operating the reuse facility beyond the expiration date of this permit, the permittee shall contact DEQ and schedule a pre-application workshop to discuss the compliance status of the facility and the content required for the reuse permit application package.</p>								
CA-095-08 Six (6) months before permit expiration	<p>Renewal Permit Application: The permittee shall submit to DEQ a complete permit renewal application package, which fulfills the requirements specified at the pre-application workshop identified in CA-095-07.</p>								

4. Permit Limits and Conditions

4.1 Hydraulic Management Unit Descriptions

Serial Number	Description	Irrigation System Type and Irrigation Efficiency	Maximum Acres ^a Allowed
MU-09501	Field CP-N	Pivot: ($E_i = 0.80$)	116
MU-09502	Field CP-S	Pivot: ($E_i = 0.80$)	116
MU-09503	Field F-N	Pivot: ($E_i = 0.80$)	31.8
MU-09505	Corner Pivot Areas (CP-N2, 3, and 4; CP-S1 and 2; CP-17B1)	Pivot: ($E_i = 0.80$)	31.4
MU-09506	Field CP-17B	Pivot: ($E_i = 0.80$)	88.2
Total acreage			383.4

- a. Maximum acres represent the total permitted acreage of the MU as provided by the permittee. If the permittee uses less acreage in any season or year, then loading rates shall be presented and compliance shall be determined based on the actual acreage utilized during each season or year.

4.2 Hydraulic Loading Limits

Serial Number	Growing Season Hydraulic Loading	Non-growing Season Maximum Hydraulic Loading, Inches ^a
MU-09501	Substantially at the irrigation water requirement (IWR) ^b	5.8
MU-09502	Substantially at the irrigation water requirement (IWR) ^b	5.8
MU-09503	Substantially at the irrigation water requirement (IWR) ^b	5.8
MU-09505	Substantially at the irrigation water requirement (IWR) ^b	5.8
MU-09506	Substantially at the irrigation water requirement (IWR) ^b	5.8

- a. Record daily, as necessary, abnormal conditions as a result of non-growing season application including ponding, excessive ice buildup, or runoff from the permitted site.
- b. For compliance purposes, the source of P_{def} data used to calculate the IWR shall be specified in the PO.

4.3 Constituent Loading Limits

Serial Number	Constituent Loading (from all sources)			
	Nitrogen (lb/acre)	Salt (NVDS) (lb/acre)	COD growing season (lb/acre-day) ^a	COD non-growing season (lb/acre-day) ^a
MU-09501 MU-09502 MU-09503 MU-09505 MU-09506	150% of typical crop uptake ^b	—	50	50

- a. COD limits are expressed in pounds per acre per day (lb/acre-day) based on a seasonal average.
- b. Typical crop uptake is the median constituent crop uptake from the 3 most recent years the crop has been grown. For crops having less than 3 years of on-site crop uptake data: other crop yield data or nutrient content values may only be used if approved in writing by DEQ in advance of use. If written approval is not provided by DEQ, compliance with the 150% nitrogen loading limit shall be determined by comparing the current year nitrogen loading to the current year nitrogen uptake.

4.4 Management Unit Buffer Zones

Serial Number	Public Water Supplies	Private Water Supplies	Inhabited Dwellings	Permanent and Intermittent Surface Water	Irrigation Ditches and Canals	Areas Accessible to the Public
MU-09501 MU-09502 MU-09503 MU-09505 MU-09506	1,000	500 ^a	300 ^b	100	50	50

- a. The Trunnel well is within the 500 foot buffer zone, but was given an exemption after a review of capture zone analyses.
- b. Low hanging spray nozzle drop tubes are required for the portion of pivot CP-17B that comes within 300 feet of the two homes at the northeast corner of MU-09506. One home is 165 feet from the application area and the other 220 feet away.

4.5 Other Permit Limits and Conditions

Category	Permit Limits and Conditions
Growing season	March 15 through October 31 (214 days)
Non-growing season	November 1 through March 14 (151 days)
Reporting year for annual loading rates	November 1 through October 31
Grazing	Prior to grazing, the permittee shall submit a Grazing Management Plan and receive written approval from DEQ.
Construction plans	Pursuant to Idaho Code §39-118, IDAPA 58.01.16, and IDAPA 58.01.17, detailed plans and specifications shall be submitted to DEQ for review and approval prior to construction, modification, or expansion of any wastewater treatment, storage, conveyance structures, ground water monitoring wells, or reuse facility. Inspection requirements shall be satisfied and within 30 days of completion of construction, and the permittee shall submit as-built plans or a letter from an Idaho Professional Engineer certifying the facilities or structures were constructed in substantial accordance with the approved plans and specifications.
Posting	Signs reading "No Trespassing" or equivalent shall be posted at a minimum of quarter mile intervals and at each corner and vehicle entrance point around the outer perimeter of the irrigated site. Signs reading "Caution: Recycled Water – Do Not Enter", or equivalent signage in both English and Spanish, shall be posted at the entrance to the reuse site lagoons. It is recommended that similar signage also be posted at all vehicle entrances to the reuse site.
Backflow prevention and testing requirements	Backflow prevention is required to protect surface water and ground water from an unauthorized discharge of recycled water or wastewater. Refer to Section 9.1.1 of this permit.
Records retention requirements	Keep records generated to meet the requirements of this permit for the duration of permit, including administrative extensions, plus 2 years.

5. Monitoring Requirements

5.1 Recycled Water and Supplemental Irrigation Water Sampling and Analyses

5.1.1 Constituent Monitoring

Monitoring Point Serial Number and Location	Sample Description	Sample Type and Frequency	Constituents (Units in mg/L Unless Otherwise Specified)
WW-09501	Effluent downstream of DAF Unit	24 hour Composite/ monthly	<ul style="list-style-type: none"> • Total Kjeldahl Nitrogen • Nitrite+Nitrate Nitrogen • COD • TDS • VDS • NVDS (calculated) • Total Phosphorus • Chloride • Oil and Grease • pH • Sulfate • Sodium • Magnesium • Calcium • Potassium
		24 hour Composite / four times during the first year after permit issuance: April, July, October, and January	<ul style="list-style-type: none"> • HCO_3^- (meq/L) • CO_3^{2-} (meq/L)
WW-09502	Wastewater into DAF unit	24 hour Composite/ Quarterly (January, April, July, and October)	<ul style="list-style-type: none"> • COD • Oil and Grease • pH • Dissolved Oxygen
WW-09503	Plant site lagoon (LG-09501)	Grab/ daily when wastewater is present	<ul style="list-style-type: none"> • Dissolved Oxygen
WW-09504	Sump at reuse site lagoons (LG-09504 and LG-09505)	Grab/ daily when wastewater is present	<ul style="list-style-type: none"> • Dissolved Oxygen

Monitoring Point Serial Number and Location	Sample Description	Sample Type and Frequency	Constituents (Units in mg/L Unless Otherwise Specified)
IW-09501	Supplemental irrigation water, from canal	Grab/ April and September	<ul style="list-style-type: none"> • Nitrite+Nitrate Nitrogen • COD • Total Kjeldahl Nitrogen • TDS • VDS • NVDS (calculated) • Chloride • Sulfate • Sodium • Magnesium • Calcium
IW-09502	Supplemental irrigation water, from the ground water source expected to produce the greatest irrigation volume for the year	Grab/ April and September	<ul style="list-style-type: none"> • Nitrite+Nitrate Nitrogen • COD • Total Kjeldahl Nitrogen • TDS • VDS • NVDS (calculated) • Chloride • Sulfate • Sodium • Magnesium • Calcium

5.1.2 Management Unit and Other Flow Monitoring

Management Unit or Flow Measurement Serial Number and Location	Sample Description	Sample Type and Frequency	Measured Parameters, each MU
FM-09501	Mag Meter, effluent flow to lagoons, backup DAF outflow meter	<ul style="list-style-type: none"> • Daily meter reading • Monthly compilation of data 	<ul style="list-style-type: none"> • Volume (MG/month) • Volume (MG/year)
FM-09502	Meter #2, Flow from old irrigation well to MUs or to storage lagoon	<ul style="list-style-type: none"> • Daily meter reading • Monthly compilation of data 	<ul style="list-style-type: none"> • Volume (MG/month) • Volume (MG/year) • Application Depth (inches/month)
FM-09503	Meter #3, Flow from sump at reuse site to MUs	<ul style="list-style-type: none"> • Daily meter reading • Monthly compilation of data 	<ul style="list-style-type: none"> • Volume (MG/month) • Volume (MG/year) • Application Depth (inches/month)
FM-09504	Meter #4, DAF inflow	<ul style="list-style-type: none"> • Daily meter reading • Monthly compilation of data 	<ul style="list-style-type: none"> • Volume (MG/month) • Volume (MG/year)
FM-09505	Meter #5, Total Flow to Field CP-17B (MU-09506)	<ul style="list-style-type: none"> • Daily meter reading • Monthly compilation of data 	<ul style="list-style-type: none"> • Volume (MG/month) • Volume (MG/year) • Application Depth (inches/month)
FM-09506	Meter #6, Total Flow to Field CP-S (MU-09502)	<ul style="list-style-type: none"> • Daily meter reading • Monthly compilation of data 	<ul style="list-style-type: none"> • Volume (MG/month) • Volume (MG/year) • Application Depth (inches/month)
FM-09507	Meter #7, Total Flow to Field CP-N (MU-09501)	<ul style="list-style-type: none"> • Daily meter reading • Monthly compilation of data 	<ul style="list-style-type: none"> • Volume (MG/month) • Volume (MG/year) • Application Depth (inches/month)
FM-09508	Meter #8, Flow from new irrigation well (Installed 2007)	<ul style="list-style-type: none"> • Daily meter reading • Monthly compilation of data 	<ul style="list-style-type: none"> • Volume (MG/month) • Volume (MG/year) • Application Depth (inches/month)
FM-09509	Parshall Flume, Flow from DAF to irrigation storage lagoons or directly to MUs	<ul style="list-style-type: none"> • Daily meter reading • Monthly compilation of data 	<ul style="list-style-type: none"> • Volume (MG/month) • Volume (MG/year) • Application Depth (inches/month)

5.2 Ground Water Monitoring

5.2.1 Ground Water Monitoring Point Descriptions

Monitoring Point Serial Number	Common Designation	Well Type	Gradient Location
GW-09501	MW-1S	Monitoring well	Upgradient of MU-09503
GW-09502	MW-2S	Monitoring well	Down or Sidegradient of MU-09503
GW-09503	MW-3S	Monitoring well	Downgradient of MU-09503
GW-09504	MW-4S	Monitoring well	Down or Sidegradient of MU-09501 and MU-09505
GW-09505	MW-5S	Monitoring well	Down or Sidegradient of MU-09501 and MU-09505
GW-09506	MW-6S	Monitoring well	Downgradient of MU-09502
GW-09507	MW-6D	Monitoring well	Downgradient of MU-09502
GW-09508	MW-1D	Monitoring well	Upgradient of MU-09503
GW-09509	MW-6XD	Monitoring well	Downgradient of MU-09502
GW-09510	MW-7S	Monitoring well	Upgradient of MU-09501 (inactive, replaced by MW-7SB)
GW-09511	MW-8S	Monitoring well	Sidegradient of MU-09503
GW-09512	MW-9S	Monitoring well	Upgradient of MU-09503
GW-09513	MW-10S	Monitoring well	Upgradient of MU-09506 (inactive, replaced by MW-10SB)
GW-09514	MW-11S	Monitoring well	Down or Sidegradient of MU-09506
GW-09515	MW-12S	Monitoring well	Downgradient of MU-09506
GW-09516	MW-7SB	Monitoring well	Upgradient of MU-09501
GW-09517	MW-10SB	Monitoring well	Upgradient of MU-09506

5.2.2 Ground Water Monitoring, Sampling, and Analyses

Monitoring Point Serial Number	Sampling Point Description	Sample Type and Frequency	Constituents ^a (Units in mg/L Unless Otherwise Specified)
GW-09507 GW-09508 GW-09509 GW-09511 GW-09512 GW-09514	Monitoring wells	Grab sample / twice annually: April and October	<ul style="list-style-type: none"> • Water Table Elevation (feet) • Water Table Depth (feet)
GW-09501 GW-09502 GW-09503 GW-09504 GW-09505 GW-09506 GW-09515 GW-09516 GW-09517	Monitoring wells	Grab sample/ twice annually: April and October	<ul style="list-style-type: none"> • Water Table Elevation (feet) • Water Table Depth (feet) • Nitrate-Nitrogen • Total Phosphorus • TDS • Chloride • Total Iron • Total Manganese • Sulfate • pH (SU) • Electrical Conductivity (umhos/cm)^a
Private Wells	Murray, Rogers, and Johnson Wells	Grab sample/ four times during the first year after permit issuance: April, July, October, and January	<ul style="list-style-type: none"> • Nitrate-Nitrogen • TDS • Total and dissolved Iron • Total and dissolved Manganese • Ca²⁺ (meq/L) • Mg²⁺ (meq/L) • Na⁺ (meq/L) • K⁺ (meq/L) • HCO₃⁻ (meq/L) • CO₃²⁻ (meq/L) • SO₄²⁻ (meq/L) • Cl⁻ (meq/L)

a. Electrical conductivity is only required to be measured in the field in accordance with EPA methods.

5.3 Soil Monitoring

5.3.1 Soil Monitoring Unit Descriptions

Monitoring Point Serial Number	Description	Associated Hydraulic Management Unit
SU-09501	Field CP-N and Pivot Corners CP-N2, 3, and 4	MU-09501 and part of MU-09505
SU-09502	Field CP-S and Pivot Corners CP-S1 and 2	MU-09502 and part of MU-09505
SU-09503	Field F-N	MU-09503
SU-09506	Field CP-17B and Pivot Corner CP-17B1 and 2	MU-09506 and part of MU-09505

5.3.2 Soil Monitoring, Sampling, and Analyses

Monitoring Point Serial Number	Sample Type	Sample Frequency	Constituents (Units in mg/kg Soil Unless Otherwise Specified)
SU-09501 SU-09502 SU-09503 SU-09506	Composite samples ^a	Twice annually, prior to growing season (from mid-February to mid-April) and after growing season, (from October to November)	<ul style="list-style-type: none"> • Electrical conductivity (µmhos/cm) • Nitrate-Nitrogen • Ammonium-Nitrogen • Plant Available Phosphorus • pH

- a. The number of sample locations specified in the PO or QAPP for each SU shall be sampled. At each location, samples shall be obtained from three depths: 0–12 inches; 12–24 inches; and 24–36 inches or refusal. The samples obtained from each depth shall be composited by depth to yield three composite samples for each soil monitoring unit; one composite sample for each depth.

5.4 Crop Monitoring

5.4.1 Crop Harvest Monitoring

Associated Hydraulic Management Units	Sample Type	Sample Frequency	Parameters ^a
MU-09501 MU-09502 MU-09503 MU-09505 MU-09506	Harvested portion, each crop, each MU	Each harvest	<ul style="list-style-type: none"> • Crop Type • Harvest Date • Sample Collection Date • Harvested acreage (acres) • As-harvested ('wet') Yield in customary harvested units (tons, bushels, cwt, etc.) • As-harvested (field) moisture content (%) • Dry Yield (lbs)

a. Documentation of reported yields shall be provided for each harvest from each MU.

5.4.2 Plant Tissue Monitoring

Associated Hydraulic Management Units	Sample Type	Sample Frequency	Parameters ^a
MU-09501 MU-09502 MU-09503 MU-09505 MU-09506	Harvested portion, each crop, each harvest	Each harvest	<ul style="list-style-type: none"> • Total Kjeldahl Nitrogen, (%) • Nitrate Nitrogen, as N (%) • Phosphorus as P (%) • Ash (%)

a. Report dry-basis results for all parameters.

5.5 Lagoon Information

Serial Number	Description	Surface Area, acres	Maximum Operating Volume, MG	Liner Type
LG-09501	Three hydraulically connected aerated lagoons at the plant site, one large lagoon and two smaller lagoons	1.0	1.9 MG for large lagoon	80 mil HDPE and 40 mil HDPE for one of the smaller plant lagoons
LG-09504	Land application site, Process Water Lagoon	0.09	0.7 MG	40 mil HDPE
LG-09505	Land application site, Mixing Lagoon	0.75	3.2 MG	40 mil HDPE

6. Reporting Requirements

6.1 Annual Report Requirements

The permittee shall submit to DEQ an annual report prepared by a competent environmental professional, covering the previous reporting year.

6.1.1 Due Date

The annual report is due no later than January 31 of each year, which shall cover the previous reporting year.

6.1.2 Required Contents

The annual report shall include the following:

1. A brief interpretive discussion of all required monitoring data. The discussion shall address data quality objectives, validation, and verification; permit compliance; and reuse facility environmental impacts. The reporting year for this permit is specified in Section 4.5.
2. Results of the required monitoring as described in Section 5 of this permit. If the permittee monitors any parameter for compliance purposes more frequently than required by this permit, the results of this monitoring shall be included in the calculation and reporting of the data submitted in the annual report. The report shall present all monitoring data in organized data summary tables to expedite review.
3. Status of all work described in Section 3 of this permit.
4. Results of all backflow testing, repairs, and replacements required by Section 9.1.1 of this permit.
5. Discussion of major maintenance activities such as major equipment replacement, lagoon liner maintenance, and wastewater treatment and reuse facility maintenance.
6. A summary of all non-compliance events that occurred during the reporting year. Examples of non-compliance events that must be discussed include, but are not limited to: complaints, missed monitoring events, incorrect monitoring dates or frequencies, dry monitoring wells, uncontained spills causing runoff, construction without DEQ engineering plan approval, construction without engineering inspection, and reporting incorrect acreage.
7. Submittal of the calculations and observations for hydraulic management units specified in the table below.
8. All laboratory analytical reports, chain of custody forms, and crop yield documentation.
9. The parameters in the following table:

Monitoring Point Serial Number	Parameter (Calculate for each MU)	Units
MU-09501 MU-09502 MU-09503 MU-09505 MU-09506 WW-09501 WW-09502 WW-09503 IW-09501 IW-09502	Recycled water loading rate	<ul style="list-style-type: none"> • MG/month • Inches/month • MG during growing season • Inches during growing season • MG during non-growing season • Inches during non-growing season
	Irrigation water loading rate	<ul style="list-style-type: none"> • Million gallons/month • Inches/month
	Irrigation water requirement (IWR) for each crop grown	<ul style="list-style-type: none"> • Inches/month • Inches/GS
	COD loading rate: growing season seasonal average	Pounds/acre-day
	COD loading rate: Non-growing season seasonal average	Pounds/acre-day
	Recycled water nitrogen, phosphorus, and NVDS loading rates, for the growing and non-growing season	Pounds/acre-year
	Supplemental Irrigation water nitrogen and NVDS loading rates	Pounds/acre-year
	Fertilizer and soil amendment application rates, reported as elemental N and P	Pounds/acre-year
	Waste solids nitrogen and phosphorus application rates	Pounds/acre-year
	Crop Harvest and Yield Report each harvest and the annual totals for each MU.	<ul style="list-style-type: none"> • Crop Types Harvested • Total Harvested Area (acres/yr) • Total 'wet' yield (lb/yr, lb/acre-yr) • Total 'dry' yield (lb/yr, lb/acre-yr)
	Crop nitrogen, phosphorus, and ash removal rates (dry-basis) Report each harvest and the annual totals for each MU.	<ul style="list-style-type: none"> • Pounds-N/acre-year • Pounds-P/acre-year • Pounds Ash/acre-year
<p>Other Reporting Requirements:</p> <ol style="list-style-type: none"> 1. Include a report of high and low air temps and precipitation for each 24-hour period during the non-growing season. Data from the Parma Agrimet Station can be substituted for daily temperatures and precipitation. 2. Submit an update of the statistical review following the protocol previously approved by DEQ in LA-000095-02 (CA-095-02). 		

6.1.3 Submittals

All applications, annual reports, or information submitted to DEQ, as required by this permit, shall be signed and certified as follows:

1. Permit applications shall be signed by the Responsible Official as follows:
 - a. For a corporation: by a responsible corporate officer;
 - b. For a partnership or sole proprietorship: by a general partner or the proprietor, respectively;
 - c. For a municipality, state, federal, Indian tribe, or other public agency: by either the principal executive officer or ranking, elected official.
2. Annual reports and other information requested by DEQ shall be signed by the responsible official or by a duly authorized representative of that person. A person is a duly authorized representative only if:
 - a. The authorization is made in writing by the responsible official;
 - b. The authorization specifies either an individual or position having responsibility for the overall operation of the regulated facility, such as the position of plant manager, superintendent, position of equivalent responsibility, or an individual having overall responsibility for environmental matters for the company; and
 - c. The written authorization is submitted to DEQ.

Submit the annual report to the following DEQ regional office at this address:

Engineering Manager
Idaho Department of Environmental Quality
Boise Regional Office
1445 N. Orchard St.
Boise, ID 83706

The annual report shall include the following certification statement and be signed, dated, and certified by the permittee's Responsible Official or duly Authorized Representative:

"I certify that the information provided in this submittal was prepared in conformance with the Quality Assurance Project Plan required by permit I-095-04, and is to the best of my knowledge, true, accurate and complete and I acknowledge that knowing submission of false or incomplete information may result in permit revocation as provided for in IDAPA 58.01.17.920.01 or other enforcement action as provided for under Idaho law."

Permit applications shall include the following certification statement and be signed, dated, and certified by the permittee's Responsible Official:

"I certify that the information provided in this submittal is, to the best of my knowledge, true, accurate and complete and I acknowledge that knowing submission of false or incomplete information may result in permit revocation as provided for in IDAPA 58.01.17.920.01, non-issuance of the permit, or other enforcement action as provided for under Idaho law."

Other information submitted to DEQ as required by the permit shall include the above certification statement and be signed, dated, and certified by the permittee's Responsible Official or duly Authorized Representative.

6.2 Emergency and Non-compliance Reporting

Report non-compliance incidents to DEQ's regional office at (208) 373-0550 or toll-free (888) 800-3480.

In case of emergencies, call the emergency 24-hour number at 1-800-632-8000 and DEQ's regional office.

See Section 8, "Standard Permit Conditions," and IDAPA 58.01.17.500.06 for reporting requirements for facilities.

All instances of unpermitted discharges of wastewater to surface waters of the United States shall also be reported to the Environmental Protection Agency by telephone within 24 hours from the time the permittee becomes aware of the discharge and in writing within five (5) days at this address:

NPDES/Stormwater Coordinator, USEPA Idaho Operations Office
950 W. Bannock, Suite 900
Boise, ID 83702
(208) 378-5746 / (208) 378-5744 and EPA Hot Line (206) 553-1846

7. Permit for Use of Industrial Recycled Water

The following are permit requirements for industrial recycled water and are included as terms of this permit as required by the “Recycled Water Rules,” (IDAPA 58.01.17.616).

616. PERMIT FOR USE OF INDUSTRIAL RECYCLED WATER.

Industrial recycled water shall only be used in accordance with a permit issued pursuant to these rules. Permit conditions and limitations shall be developed by the Department on a case-by-case basis taking into account the specific characteristics of the wastewater to be recycled, the treatment necessary to ensure the use of such recycled water is in compliance with IDAPA 58.01.11, “Ground Water Quality Rule” and IDAPA 58.01.02, “Water Quality Standards.” Unless otherwise indicated in this section, the permit application, processing and issuance procedures provided in this rule shall apply to industrial reuse permits. (4-7-11)

8. Standard Permit Conditions

The following standard permit conditions are included as terms of this permit as required by the “Recycled Water Rules,” (IDAPA 58.01.17.500).

500. STANDARD PERMIT CONDITIONS.

The following conditions shall apply to and be included in all permits. (4-1-88)

- 01. Compliance Required.** The permittee shall comply with all conditions of the permit. (4-1-88)
- 02. Renewal Responsibilities.** If the permittee intends to continue operation of the permitted facility after the expiration of an existing permit, the permittee shall apply for a new permit in accordance with these rules. (4-1-88)
- 03. Operation of Facilities.** The permittee shall at all times properly maintain and operate all structures, systems, and equipment for treatment, control and monitoring, which are installed or used by the permittee to achieve compliance with the permit or these rules. (4-1-88)
- 04. Provide Information.** The permittee shall furnish to the Director within a reasonable time, any information including copies of records, which may be requested by the Director to determine whether cause exists for modifying, revoking, re-issuing, or terminating the permit, or to determine compliance with the permit or these rules. (4-1-88)
- 05. Entry and Access.** The permittee shall allow the Director, consistent with Title 39, Chapter 1, Idaho Code, to:
 - a.** Enter the permitted facility. (4-1-88)
 - b.** Inspect any records that must be kept under the conditions of the permit. (4-1-88)
 - c.** Inspect any facility, equipment, practice, or operation permitted or required by the permit. (4-1-88)
 - d.** Sample or monitor for the purpose of assuring permit compliance, any substance or any parameter at the facility. (4-1-88)
- 06. Reporting.** The permittee shall report to the Director under the circumstances and in the manner specified in this section:
 - a.** In writing at least thirty (30) days before any planned physical alteration or addition to the

permitted facility or activity if that alteration or addition would result in any significant change in information that was submitted during the permit application process. When the alteration or addition results in a need for a major modification, such alteration or addition shall not be made prior to Department approval issued in accordance with these rules. (4-7-11)

b. In writing thirty (30) days before any anticipated change which would result in noncompliance with any permit condition or these rules. (4-1-88)

c. Orally within twenty-four (24) hours from the time the permittee became aware of any noncompliance which may endanger the public health or the environment at telephone numbers provided in the permit by the Director. (4-1-88)

d. In writing as soon as possible but within five (5) days of the date the permittee knows or should know of any noncompliance unless extended by the Department. This report shall contain: (4-1-88)

i. A description of the noncompliance and its cause; (4-1-88)

ii. The period of noncompliance including to the extent possible, times and dates and, if the noncompliance has not been corrected, the anticipated length of time it is expected to continue; and (4-7-11)

iii. Steps taken or planned, including timelines, to reduce or eliminate the continuance or reoccurrence of the noncompliance. (4-7-11)

e. In writing as soon as possible after the permittee becomes aware of relevant facts not submitted or incorrect information submitted, in a permit application or any report to the Director. Those facts or the correct information shall be included as a part of this report. (4-1-88)

07. Minimize Impacts. The permittee shall take all necessary actions to eliminate and correct any adverse impact on the public health or the environment resulting from permit noncompliance. (4-1-88)

08. Compliance with “Ground Water Quality Rule.” Permits issued pursuant to these rules shall require compliance with IDAPA 58.01.11, “Ground Water Quality Rule.” (4-7-11)

9. General Permit Conditions

The following general permit conditions are based on the cited rules at the time of issuance and are enforceable as part of this permit. Note that the rules cited in this section, and elsewhere in this permit, are supplemented by the rules themselves. Rules applicable to your facility are enforceable whether or not they appear in this permit.

9.1 Operations

9.1.1 Backflow Prevention

Reuse facilities with existing or planned cross-connections or interconnections between the recycled water system and any water supply (potable or nonpotable) or surface water, shall have backflow prevention assemblies, devices, or methods as required by applicable rule or as specified in this permit and approved by DEQ.

For public water systems, backflow assemblies shall meet the requirements of IDAPA 58.01.08.543. Assemblies shall be adequately maintained and shall be tested annually by a certified backflow assembly tester, and repaired or replaced as necessary to maintain operational status.

For domestic water supply wells, backflow prevention devices shall meet the requirements of IDAPA 07.02.04 and shall be adequately operated and maintained.

Irrigation water supply wells shall meet the requirements of IDAPA 37.03.09.36 for preventing any waste or contamination of the ground water resource. Backflow prevention assemblies or devices used to protect the ground water shall be adequately operated and maintained.

Discharge of recycled water to surface water is regulated by the EPA NPDES program. An NPDES permit is required for any discharge to surface water, and backflow prevention shall be implemented to prevent any unauthorized discharge. Backflow prevention assemblies or devices used to protect surface water shall be adequately operated and maintained.

Records of all testable backflow assembly test results, repairs, and replacements shall be kept at the reuse facility along with other operational records, and shall be discussed in the Annual Report and made available for inspection by DEQ. Other approved means of backflow prevention, such as siphons and air-gap structures that cannot be tested, shall be maintained in operable order.

9.1.2 Restricted to Premises

Wastewaters or recharge waters applied to the land surface must be restricted to the premises of the application site. Wastewater discharges to surface water that require a permit under the Clean Water Act must be authorized by the United States Environmental Protection Agency (IDAPA 58.01.16.600.02).

9.1.3 Health Hazards, Nuisances, and Odors Prohibited

Health hazards, nuisances, and odors are prohibited as follows:

- Wastewater must not create a public health hazard or nuisance condition (IDAPA 58.01.16.600.03).
- No person shall allow, suffer, cause, or permit the emission of odorous gases, liquids, or solids into the atmosphere in such quantities as to cause air pollution (IDAPA 58.01.01.776.01).
- Air Pollution. The presence in the outdoor atmosphere of any air pollutant or combination thereof in such quantity of such nature and duration and under such conditions as would be injurious to human health or welfare, to animal or plant life, or to property, or to interfere unreasonably with the enjoyment of life or property (IDAPA 58.01.01.006.06).

9.1.4 Solids Management

Biosolids are the nutrient-rich organic materials resulting from the treatment of sewage sludge. When treated and processed, sewage sludge becomes biosolids which can be safely recycled and applied as fertilizer to sustainably improve and maintain productive soils and stimulate plant growth.

Biosolids generated from sewage sludge are regulated by EPA under 40 CFR Part 503 and require a DEQ-approved Sludge Disposal Plan as outlined in IDAPA 58.01.16.650. Contact DEQ prior to application of biosolids at any permitted reuse facility.

Sludge is the semi-liquid mass produced and removed by wastewater treatment processes. This does not include grit, garbage, and large solids.

Sludge may be generated by wastewater treatment processes at municipal and industrial facilities. A DEQ-approved sludge disposal plan, as outlined in IDAPA 58.01.16.650, may be required.

Solid Waste is any garbage or refuse, sludge from a waste water treatment plant, water supply treatment plant, or air pollution control facility and other discarded material including solid, liquid, semi-solid, or contained gaseous material resulting from industrial, commercial, mining, and agricultural operations and from community activities, but does not include solid or dissolved materials in domestic sewage, or solid or dissolved material in irrigation return flows or industrial discharges which are point sources subject to permits under Section 402 of the Federal Water Pollution Control Act, as amended or source, special nuclear, or by-product material as defined by the Atomic Energy Act of 1954, as amended.

Solid waste does not include inert wastes, manures, and crop residues ultimately returned to the soils at agronomic rates, and any agricultural solid waste which is managed and regulated pursuant to rules adopted by the Idaho Department of Agriculture. DEQ reserves the right to use existing authorities to regulate agricultural waste that impacts human health or the environment.

Solid waste is regulated under IDAPA 58.01.06, "Solid Waste Management Rules." Wastes otherwise regulated by DEQ (i.e., this permit) are not regulated under 58.01.06.

Waste Solids include sludge and wastes otherwise regulated by DEQ in accordance with IDAPA 58.01.06.001.03.a.xii. Waste solids may include vegetative waste, silt, and mud containing organic matter, and other non-inert solid wastes.

Inert wastes are defined as non-combustible, non-hazardous, and non-putrescible solid wastes that are likely to retain their physical and chemical structure and have a deminimis potential to generate leachate under expected conditions of disposal, which includes resistance to biological attack.

Waste solids require a DEQ-approved Sludge Disposal Plan as outlined in IDAPA 58.01.16.650.

9.1.5 Temporary Cessation of Operations and Closure (IDAPA 58.01.17.801)

Temporary cessation of operations and closure must be addressed as follows:

01. Temporary Cessation. A permittee shall implement any applicable conditions specified in the permit for temporary cessation of operations. When the permit does not specify applicable temporary cessation conditions, the permittee shall notify the Director prior to a temporary cessation of operations at the facility greater than sixty (60) days in duration and any cessation not for regular maintenance or repair. Cessation of operations necessary for regular maintenance or repair of a duration of sixty (60) days or less are not required to notify the Department under this section. All notifications required under this section shall include a proposed temporary cessation plan that will ensure the cessation of operations will not pose a threat to human health or the environment. (4-7-11)

02. Closure. A closure plan shall be required when a facility is closed voluntarily and when a permit is revoked or expires. A permittee shall implement any applicable conditions specified in the permit for closure of the facility. Unless otherwise directed by the terms of the permit or by the Director, the permittee shall submit a closure plan to the Director for approval at least ninety (90) days prior to ceasing operations. The closure plan shall ensure that the closed facility will not pose a threat to human health and the environment. Closure plan approval may be conditioned upon a permittee's agreement to complete such site investigations, monitoring, and any necessary remediation activities that may be required. (4-7-11)

9.1.6 Plan of Operation (IDAPA 58.01.17.300.05)

The PO must comply with the following:

05. Reuse Facility Operation and Maintenance Manual or Plan of Operations. A facility's operation and maintenance manual must contain all system components relating to the reuse facility in order to comply with IDAPA 58.01.16 "Wastewater Rules," Section 425. Manuals and manual amendments are subject to the review and approval provision therein. In addition to the content required by IDAPA 58.01.16.425, manuals for reuse facilities shall include, if applicable: operation and management responsibility, permits and standards, general plant description, operation and control of unit operations, land application site maps, wastewater characterization, cropping plan, hydraulic loading rate, constituent loading rates, compliance activities, seepage rate testing, site management plans, monitoring, site operations and maintenance, solids handling and processing, laboratory testing, general maintenance, records and reports, store room and inventory, personnel, an emergency operating plan, and any other information required by the Department. (4-7-11)

9.1.7 Reserved

9.1.8 Ground Water Quality Rule (IDAPA 58.01.11)

The permittee shall comply with the requirements of "Ground Water Quality Rule" (IDAPA 58.01.11).

9.2 Administrative

Requirements for administration of the permit are defined as follows:

9.2.1 Permit Modification (IDAPA 58.01.17.700)

01. Modification of Permits. A permit modification may be initiated by the receipt of a request for modification from the permittee, or may be initiated by the Department if one (1) or more of the following causes for modification exist: (4-7-11)

a. Alterations. There are material and substantial alterations or additions to the permitted facility or activity which occurred after permit issuance which justify the application of permit conditions that are different or absent in the existing permit. (4-7-11)

b. New standards or regulations. The standards or regulations on which the permit was based have been changed by promulgation of amended standards or regulations or by judicial decision after the permit was issued. (4-7-11)

c. Compliance schedules. The Department determines good cause exists for modification of a compliance schedule or terms and conditions of a permit. (4-7-11)

d. Non-limited pollutants. When the level of discharge of any pollutant which is not limited in the permit exceeds the level which may cause an adverse impact to surface or ground waters. (4-7-11)

e. To correct technical mistakes, such as errors in calculation, or mistaken interpretations of law made in determining permit conditions. (4-7-11)

f. When a treatment technology proposed, installed, and properly operated and maintained by the permittee fails to achieve the requirements of the permit. (4-7-11)

9.2.2 Permit Transferable (IDAPA 58.01.17.800)

01. General. A permit may be transferred only upon approval of the Department. No transfer is required for a corporate name change as long as the secretary of state can verify that a change in name alone has occurred. An attempted transfer is not effective for any purpose until approved in writing by the Department. (4-7-11)

9.2.3 Permit Revocation (IDAPA 58.01.17.920)

01. Conditions for Revocation. The Director may revoke a permit if the permittee violates any permit condition or these rules, or the Director becomes aware of any omission or misrepresentation of condition or information relied upon when issuing the permit. (4-7-11)

02. Notice of Revocation. Except in cases of emergency, the Director shall issue a written notice of intent to revoke to the permittee prior to final revocation. Revocation shall become final within thirty-five (35) days of receipt of the notice by the permittee, unless within that time the permittee requests an administrative hearing in writing. The hearing shall be conducted in accordance with IDAPA 58.01.23, Rules of Administrative Procedure Before the Board of Environmental Quality.” (5-3-03)

03. Emergency Action. If the Director finds the public health, safety or welfare requires emergency action, the Director shall incorporate findings in support of such action in a written notice of emergency revocation issued to the permittee. Emergency revocation shall be effective upon receipt by the permittee. Thereafter, if requested by the permittee in writing, the Director shall provide the permittee a revocation hearing and prior notice thereof. Such hearings shall be conducted in accordance with IDAPA 58.01.23, Rules of Administrative Procedure

before the Board of Environmental Quality.”

(3-15-02)

04. Revocation and Closure. A permittee shall perform the closure requirements in a permit, the closure requirements of these rules, and complete all closure plan activities notwithstanding the revocation of the permit. (4-7-11)

9.2.4 Violations (IDAPA 58.01.17.930)

Any person violating any provision of these rules or any permit or order issued thereunder shall be liable for a civil penalty not to exceed ten thousand dollars (\$10,000) or one thousand dollars (\$1,000) for each day of a continuing violation, whichever is greater. In addition, pursuant to Title 39, Chapter 1, Idaho Code, any willful or negligent violation may constitute a misdemeanor. (4-1-88)

9.2.5 Severability

The provisions of this permit are severable, and if a provision or its application is declared invalid or un-enforceable for any reason, that declaration will not affect the validity or enforceability of the remaining provisions.

10. Other Applicable Laws

DEQ may refer enforcement of the following provisions to the state agency authorized to enforce that rule. The permittee shall comply with all applicable provisions identified in this section. Compliance with this permit does not relieve the permittee from applicable requirements in other federal, state, and local laws, statutes, and rules.

10.1 Owner Responsibilities for Well Use and Maintenance

10.1.1 Well Use

The well owner must not operate any well in a manner that causes waste or contamination of the ground water resource. Failure to operate, maintain, knowingly allow the construction of any well in a manner that violates these rules, or failure to repair or properly decommission (abandon) any well as herein required will subject the well owner to civil penalties as provided by statute. See IDAPA 37.03.09.036.01 and consult the Idaho Department of Water Resources (IDWR) for more information.

10.1.2 Well Maintenance

The well owner must maintain the well to prevent waste or contamination of ground waters through leaky casings, pipes, fittings, valves, pumps, seals, or through leakage around the outside of the casings, whether the leakage is above or below the land surface. Any person owning or controlling a non-compliant well must have the well repaired by a licensed well driller under a permit issued by the IDWR director in accordance with the applicable rules. See IDAPA 37.03.09.036.02 and consult IDWR for more information.

10.1.3 Wells Posing a Threat to Human Health and Safety or Causing Contamination of the Ground Water Resource

The well owner must have any well shown to pose a threat to human health and safety or cause contamination of the ground water resource immediately repaired or decommissioned (abandoned) by a licensed well driller under a permit issued by the IDWR director in accordance with the applicable rules. See IDAPA 37.03.09.036.06 and consult the IDWR for more information.

11. Site Maps

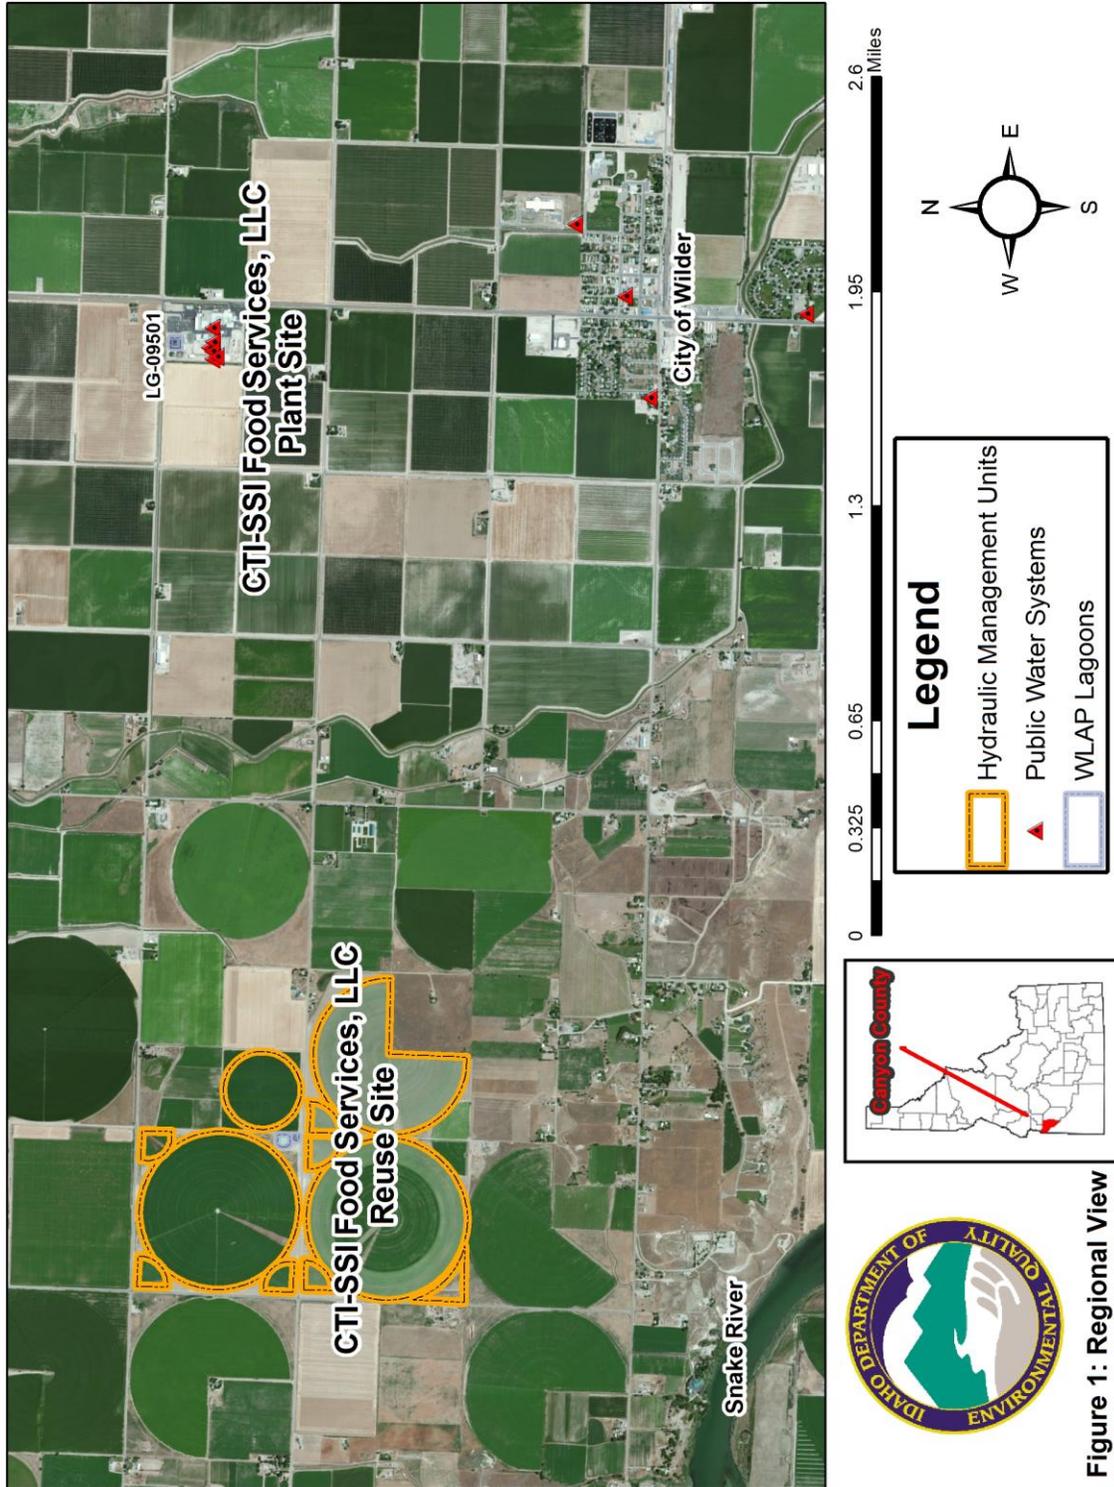


Figure 1: Regional View

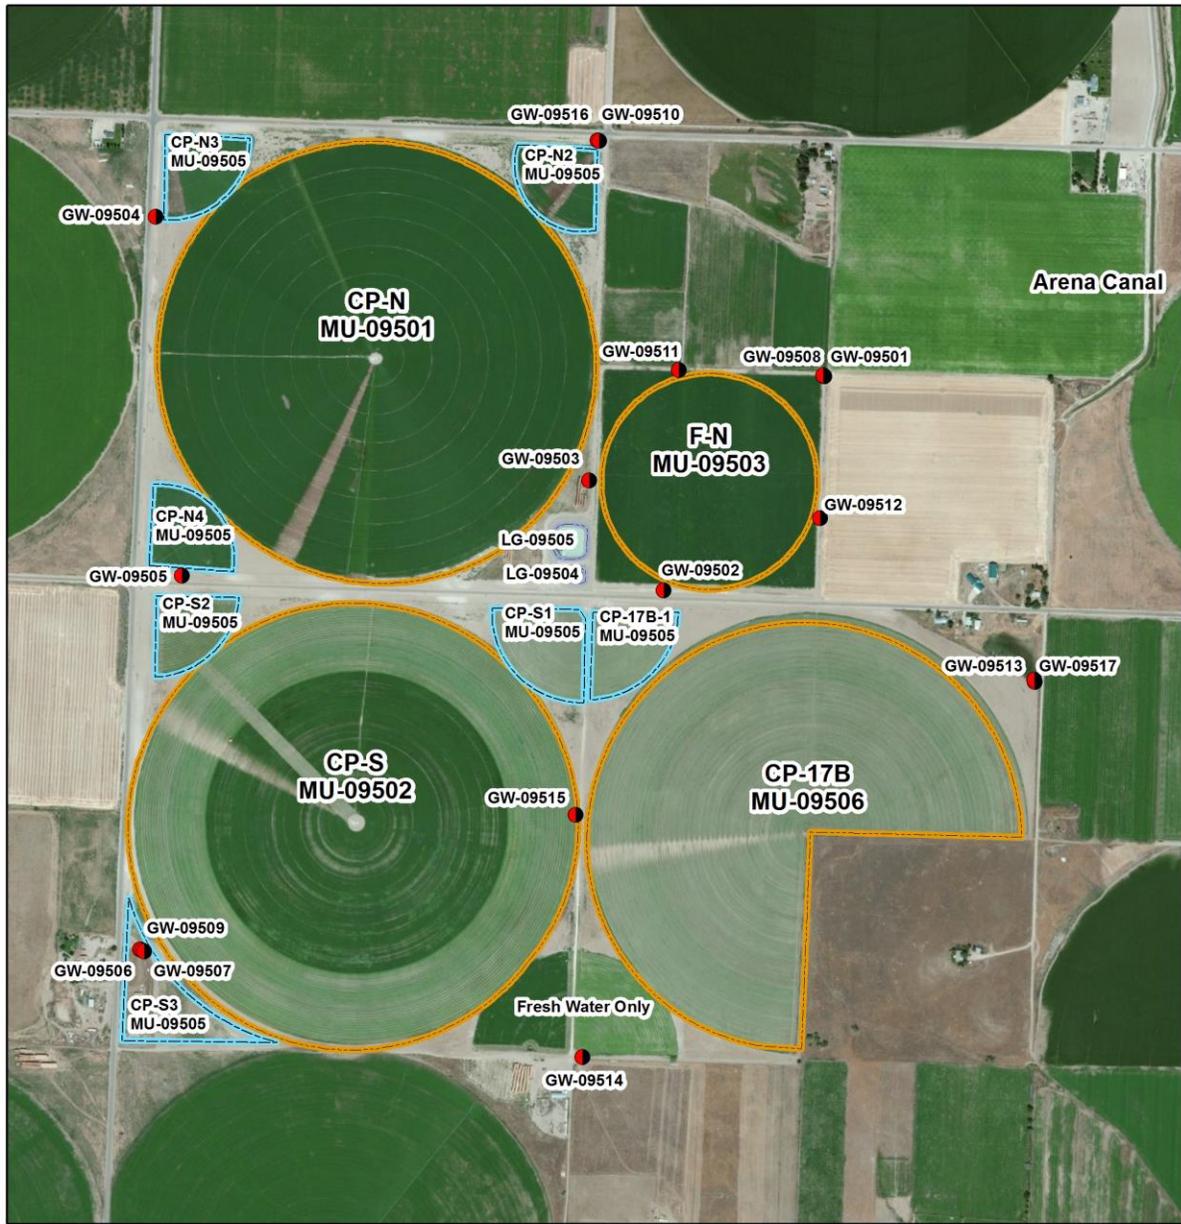


Figure 2: Site View

